

Moxa Industrial Media Converter

IMC-101 Hardware Installation Guide

Fifth Edition, April 2010



© 2010 Moxa Inc. All rights reserved.
Reproduction without permission is prohibited.

Fl.4, No.135, Lane 235, Pao-Chiao Rd. Shing Tien City, Taipei, Taiwan,
R.O.C.

TEL: +886-2-8919-1230

P/N: 1802001014024

Overview

Moxa Industrial Media Converter, which is specially designed for reliable and stable operation in harsh industrial environments, provides industrial grade media conversion between 10/100BaseT(X) and 100BaseFX. IMC-101's reliable industrial design is excellent for keeping your industrial automation applications running continuously, and comes with a relay output warning alarm to help prevent damages and losses.

This product has a wide operating temperature range, from -40 to 75°C, and is designed to withstand a high degree of vibration and shock. The rugged hardware design makes IMC-101 perfect for ensuring that your Ethernet equipment can withstand critical industrial applications, such as in hazardous locations (Class 1 Division 2/Zone 2), and complies with FCC, TÜV, UL, and CE Standards

NOTE *Throughout this Hardware Installation Guide, we often use **IMC** as an abbreviation for Moxa Industrial Media Converter:*

IMC = Moxa Industrial Media Converter

Package Checklist

Moxa Industrial Media Converter is shipped with the following items. If any of these items is missing or damaged, please contact your customer service representative for assistance.


- Moxa Industrial Media Converter
- Hardware Installation Guide
- Moxa Product Warranty booklet

Features

- Supports 10/100Base-TX auto-negotiation and auto-MDI/MDI-X
- Multi mode, single mode with SC or ST fiber connector available
- Supports Link Fault Pass-Through
- Relay Output alarm when a port breaks or the power fails
- Redundant 24 VDC (12 to 48 VDC) power inputs, DIN-Rail or panel mountable
- Operating temperature range from 0 to 60°C, or extended operating temperature from -40 to 75°C for (-T) models


Panel Layout of IMC-101 Series

Top Panel View




1. Grounding screw
2. Terminal block for power input PWR1/PWR2 and relay output
3. Heat dissipation orifices
4. Dip switch
5. Power input PWR1 LED
6. Power input PWR2 LED
7. Fault LED
8. 100BaseFX (ST connector) Port
9. FX port's 100 Mbps LED
10. FX port's Full Duplex/Collision LED
11. TP port's 100 Mbps LED
12. 10/100BaseT(X)
13. TP port's 10 Mbps LED
14. Model Name
15. 100BaseFX (SC connector) Port
16. Screw hole for wall mounting kit
17. DIN-Rail mounting kit


Front Panel View (IMC-101-M-ST)

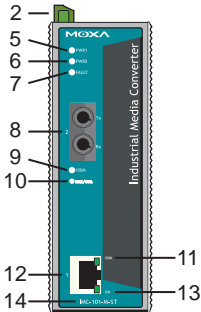

Front Panel View (IMC-101-M-SC)

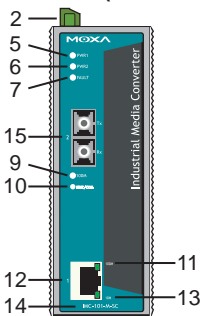


Rear Panel View




Mounting Dimensions

(Unit = mm)

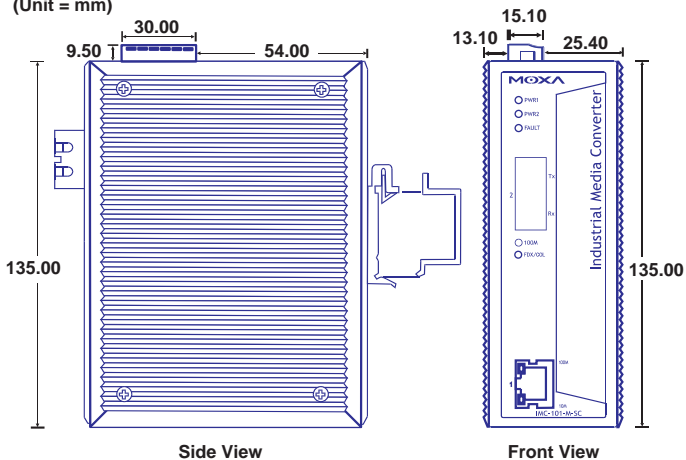

Side View

Front View

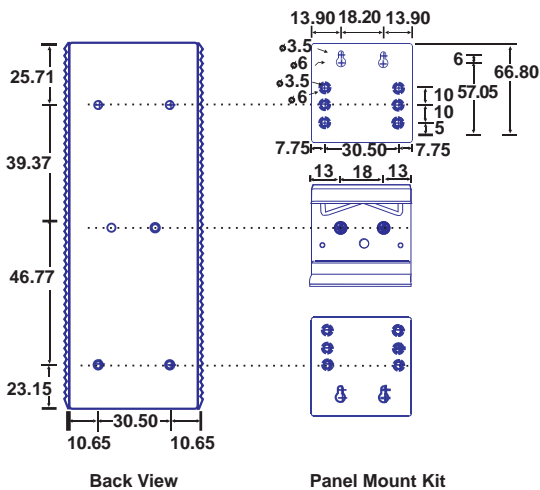

Back View


Panel Mount Kit

DIN-Rail Mounting

The aluminum DIN-Rail attachment plate should be fixed to the back panel of IMC when you take it out of the box. If you need to reattach the DIN-Rail attachment plate to IMC, make sure the stiff metal spring is situated towards the top, as shown in the figures below.


STEP 1:

Insert the top of the DIN-Rail into the slot just below the stiff metal spring.



STEP 2:

The DIN-Rail attachment unit will snap into place as shown below.




To remove Moxa Industrial Media Converter from the DIN-Rail, simply reverse Steps 1 and 2 above.

Wall Mounting (Optional)

For some applications, you will find it convenient to mount Moxa Industrial Media Converter on the wall, as illustrated below.

STEP 1:

Remove the aluminum DIN-Rail attachment plate from Moxa Industrial Media Converter, and then attach the wall mount plates, as shown in the diagrams below.

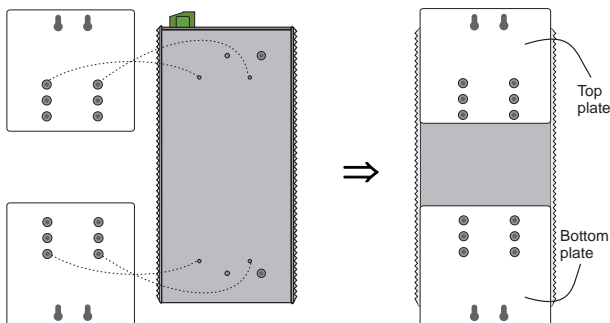


STEP 2:


Mounting Moxa Industrial Media Converter on the wall requires 4 screws. Use the IMC, with wall mount plates attached, as a guide to mark the correct locations of the 4 screws. The heads of the screws should be less than 6.0 mm in diameter, and the shafts should be less than 3.5 mm in diameter, as shown in the figure at the right.

NOTE Test the screw head and shank size by inserting the screw into one of the keyhole shaped apertures of the Wall Mounting Plates, before it is screwed into the wall.

Do not screw the screws in all the way—leave a space of about 2 mm to allow room for sliding the wall mount panel between the wall and the screws.

**STEP 3:**

Once the screws are fixed in the wall, insert the four screw heads through the large parts of the keyhole-shaped apertures, and then slide Moxa Industrial Media Converter downwards, as indicated below. Tighten the four screws for added stability.

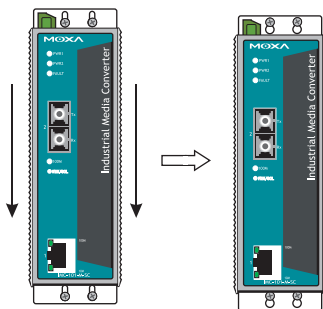

II 3G

ATEX Information

1. Certification number DEMKO 09 ATEX0812123x
2. Ambient range ($-40^{\circ}\text{C} \leq T_{\text{amb}} \leq 75^{\circ}\text{C}$)
3. Certification string (Ex nC nL IIC T4)
4. Standards covered (EN60079-0:2006, EN60079-15:2005)
5. The conditions of safe usage:



- The Ethernet Communication Devices are to be mounted in an IP54 enclosure and used in an area of not more than pollution degree 2 as defined by IEC60664-1. A 4mm² conductor must be used when a connection to the external grounding screw is used. Conductors suitable for use in an ambient temperature of 93°C must be used for the Power Supply Terminal.
- Provisions shall be made, either in external to the apparatus, to prevent the rated voltage being exceeded by the transient disturbances of more than 40%.

Wiring Requirements

WARNING



Do not disconnect modules or wires unless power has been switched off or the area is known to be non hazardous.

The devices may only be connected to the supply voltage shown on the type plate.

The devices are designed for operation with a safety extra-low voltage. Thus, they may only be connected to the supply voltage connections and to the signal contact with the safety extra-low voltages (SELV) in compliance with IEC950/ EN60950/ VDE0805.

WARNING




Substitution of components may impair suitability for Class I, Division 2 and Zone 2.

These devices must be supplied by a SELV source as defined in the Low Voltage Directive 73/23/EEC and 93/68/EEC.

WARNING



This equipment has been evaluated as EEx nC IIC T4 equipment under DEMKO Certificate No. 03 ATEX

0324537U. Each module is marked with  II 3G and is suitable for use in Zone 2 Explosive Atmospheres. Devices must be installed in a minimum IP 54 enclosure as defined in IEC 60529 and EN 60529.

ATTENTION



This unit is a built-in type. During installation into certain end equipment, it must comply with fire enclosure stipulations of IEC 60950/EN60950, or similar statements.

ATTENTION



Safety First!

Be sure to disconnect the power cord before installing and/or wiring your Moxa Industrial Media Converter.

ATTENTION



Safety First!

Calculate the maximum possible current in each power wire and common wire. Observe all electrical codes dictating the maximum current allowable for each wire size.

If the current goes above the maximum ratings, the wiring could overheat, causing serious damage to your equipment.

You should also pay attention to the following points:

- Use separate paths to route wiring for power and devices. If power wiring and device wiring paths must cross, make sure the wires are perpendicular at the intersection point.

NOTE: Do not run signal or communications wiring and power wiring in the same wire conduit. To avoid interference, wires with different signal characteristics should be routed separately.

- You can use the type of signal transmitted through a wire to determine which wires should be kept separate. The rule of thumb is that wiring that shares similar electrical characteristics can be bundled together.
- Keep input wiring and output wiring separated.
- It is strongly advised that you label wiring to all devices in the system when necessary.

Grounding Moxa Industrial Media Converter

Grounding and wire routing help limit the effects of noise due to electromagnetic interference (EMI). Run the ground connection from the ground screw to the grounding surface prior to connecting devices.

ATTENTION



This product is intended to be mounted to a well-grounded mounting surface such as a metal panel.



Wiring the Alarm Contact

The Alarm Contact is made up of the two middle contacts of the terminal block on IMC's top panel. Refer to the next section for detailed instructions on how to connect the wires to the terminal block connector, and how to attach the terminal block connector to the terminal block receptor.

In this section, we explain the meaning of the two contacts used to connect the Alarm Contact.




FAULT: The two middle contacts of the 6-contact terminal block connector are used to detect both power faults and port faults. The two wires attached to the Fault contacts form an open circuit when:

1. IMC has lost power from one of the DC power inputs.
- OR
2. One of the ports for which the corresponding PORT ALARM Dip Switch is set to ON is not properly connected.

If neither of these two conditions occurs, the Fault circuit will be closed.

Wiring the Redundant Power Inputs

The top two contacts and the bottom two contacts of the 6-contact terminal block connector on IMC's top panel are used for IMC's two DC inputs. Top and front views of one of the terminal block connectors are shown here.



STEP 1: Insert the negative/positive DC wires into the V-/V+ terminals.

STEP 2: To keep the DC wires from pulling loose, use a small flat-blade screwdriver to tighten the wire-clamp screws on the front of the terminal block connector.

STEP 3: Insert the plastic terminal block connector prongs into the terminal block receptor, which is located on IMC's top panel.

ATTENTION

Before connecting IMC to the DC power inputs, make sure the DC power source voltage is stable.



Communication Connections

IMC-101 models have one 10/100BaseT(X) Ethernet port, and one 100BaseFX (SC or ST type connector) fiber port.


10/100BaseT(X) Ethernet Port Connection

The 10/100BaseT(X) ports located on IMC's front panel are used to connect to Ethernet-enabled devices.

Below we show pinouts for both MDI (NIC-type) ports and MDI-X (HUB/Switch-type) ports, and also show cable wiring diagrams for straight-through and cross-over Ethernet cables.


RJ45 (8-pin, MDI) Port Pinouts

Pin	Signal
1	Tx+
2	Tx-
3	Rx+
6	Rx-




RJ45 (8-pin, MDI-X) Port Pinouts


Pin	Signal
1	Rx+
2	Rx-
3	Tx+
6	Tx-



RJ45 (8-pin) to RJ45 (8-pin) Straight-Through Cable Wiring

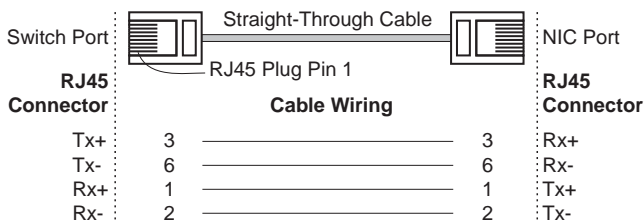

RJ45 (8-pin) to RJ45 (8-pin) Cross-Over Cable Wiring

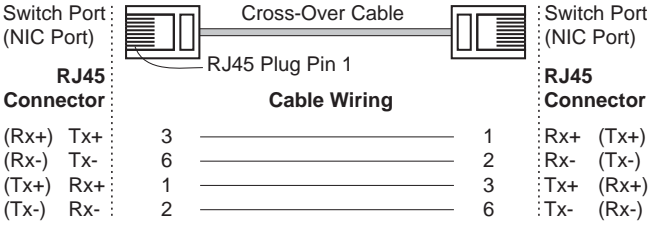


100BaseFX Ethernet Port Connection


The concept behind the SC port and cable is quite straightforward. Suppose you are connecting devices I and II. Contrary to electrical signals, optical signals do not require a circuit in order to transmit data. Consequently, one of the optical lines is used to transmit data from device I to device II, and the other optical line is used transmit data from device II to device I, for full-duplex transmission.

All you need to remember is to connect the Tx (transmit) port of device I to the Rx (receive) port of device II, and the Rx (receive) port of device I to the Tx (transmit) port of device II. If you are making your own cable, we suggest labeling the two sides of the same line with the same letter (A-to-A and B-to-B, as shown below, or A1-to-A2 and B1-to-B2).


SC-Port Pinouts




SC-Port to SC-Port Cable Wiring

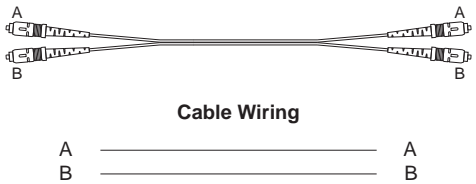

ST-Port Pinouts



ST-Port to ST-Port Cable Wiring

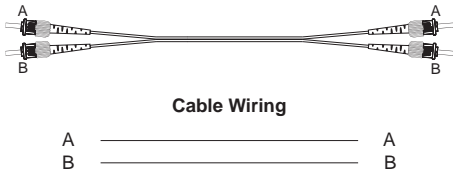

ATTENTION This is a Class 1 Laser/LED product. Do not stare into the Laser Beam.



Redundant Power Inputs

Both power inputs can be connected simultaneously to live DC power sources. If one power source fails, the other live source acts as a backup, and automatically supplies all of Moxa Industrial Media Converter's power needs.

Alarm Contact

Moxa Industrial Media Converter has one Alarm Contact located on the top panel. For detailed instructions on how to connect the Alarm Contact power wires to the two middle contacts of the 6-contact terminal block connector, see the "Wiring the Alarm Contact" section above. A typical scenario would be to connect the Fault circuit to a warning light located in the control room. The light can be set up to switch on when a fault is detected.

The Alarm Contact has two terminals that form a Fault circuit for connecting to an alarm system. The two wires attached to the Fault contacts form an open circuit when (1) IMC has lost power from one of the DC power inputs, or (2) one of the ports for which the corresponding PORT ALARM Dip Switch is set to ON is not properly connected.

If neither of these two conditions occurs, the Fault circuit will be closed.

Dip Switch Setting

IMC-101 series DIP switch

Dip Switch 1 (Default: Off)

ON: Enables the PORT Alarm. If the port's link fails, the relay will form an open circuit and the fault LED will light up.

Off: Disables the corresponding PORT Alarm. The relay will form a closed circuit and the Fault LED will never light up.


Dip Switch 2 (Default: ON)

ON: Enables full duplex for 100BaseFX

Off: Disables full duplex for 100BaseFX

Dip Switch 3

Reserved for future use



To activate the updated DIP switch setting, power off and then power on the IMC.

LED Indicators

The front panel of Moxa Industrial Media Converter contains several LED indicators. The function of each LED is described in the table below.

LED	Color	State	Description
PWR1	AMBER	On	Power is being supplied to power input PWR1
		Off	Power is not being supplied to power input PWR1
PWR2	AMBER	On	Power is being supplied to power input PWR2
		Off	Power is not being supplied to power input PWR2
FAULT	RED	On	When the corresponding PORT alarm is enabled, and the port's link is inactive.
		Off	When the corresponding PORT alarm is enabled and the port's link is active, or when the corresponding PORT alarm is disabled.
10M	GREEN	On	TP port's 10 Mbps link is active
		Blinking	Data is being transmitted at 10 Mbps
		Off	TP Port's 10 Mbps link is inactive
100M (TP)	GREEN	On	TP port's 100 Mbps link is active
		Blinking	Data is being transmitted at 100 Mbps
		Off	100BaseTX Port's link is inactive
100M (FX)	GREEN	On	FX port's 100 Mbps is active
		Blinking	Data is being transmitted at 100 Mbps
		Off	100BaseFX port is inactive
FDX/ COL	GREEN	On	100BaseFX port is being transmitted at full duplex
		Blinking	Collision occurs
		Off	100BaseFX port is being transmitted at half duplex

Auto MDI/MDI-X Connection

The Auto MDI/MDI-X function allows users to connect Moxa Industrial Media Converter's 10/100BaseTX ports to any kind of Ethernet device, without paying attention to the type of Ethernet cable being used for the connection. This means that you can use either a *straight-through* cable or *cross-over* cable to connect IMC to Ethernet devices.

Dual Speed Functionality and Switching

Moxa Industrial Media Converter's 10/100 Mbps RJ45 switched port auto negotiates with the connected device for the fastest data transmission rate supported by both devices. All models of Moxa Industrial Media Converter are plug-and-play devices, so that software configuration is not required at installation, or during maintenance. The half/full duplex mode for the RJ45 switched ports is user dependent and changes (by auto-negotiation) to full or half duplex, depending on which transmission speed is supported by the attached device.

Auto-Negotiation and Speed Sensing

All of Moxa Industrial Media Converter's RJ45 Ethernet ports independently support auto-negotiation for transmission speed in the 10BaseT and 100BaseTX modes, with operation according to the IEEE 802.3u standard. This means that some nodes could be operating at 10 Mbps, while at the same time, other nodes are operating at 100 Mbps.

Auto-negotiation takes place when an RJ45 cable connection is made, and then each time a LINK is enabled. Moxa Industrial Media Converter advertises its capability for using either 10 Mbps or 100 Mbps transmission speeds, with the device at the other end of the cable expected to advertise similarly. Depending on what type of device is connected, this will result in agreement to operate at a speed of either 10 Mbps or 100 Mbps.

If a Moxa Industrial Media Converter RJ45 Ethernet port is connected to a non-negotiating device, it will default to 10 Mbps speed and half-duplex mode, as required by the IEEE 802.3u standard.

Specifications

Technology

Standards IEEE802.3, 802.3u, Link Fault Pass-Through

Interface

RJ45 ports 10/100BaseT(X)

Fiber ports 100BaseFX (SC, ST connectors available)

LED Indicators Power, Fault, 10/100M, Full Duplex/Collision,

Dip Switch Port break alarm mask, 100BaseFx Full/Half duplex selection

Alarm Contact One relay output with current carrying capacity of 1A @ 24 VDC

Optical Fiber

	Multi mode	Single mode, 15	Single mode, 40	Single mode, 80
Distance, km	5	15	40	80
Wavelength, nm	1310	1310	1310	1550
Min. TX Output, dBm	-20	-15	-5	-5
Max. TX Output, dBm	-14	-6	0	0
Sensitivity, dBm	-34 to -30	-36 to -32	-36 to -32	-36 to -32
Recommended Diameter	62.5/125	9/125	9/125	9/125
(Core/Cladding) μm	(1 dB/km, 800 MHz \times km)			

Power

Input Voltage 24 VDC (12 to 48 VDC); Redundant inputs

Input Current (@24V) 0.16 A

Connection Removable Terminal Block

Overload Current Protection 1.1 A

Reverse Polarity Protection Present

Mechanical

Casing IP30 protection, aluminum case

Dimensions (W x H x D) 53.6 x 135 x 105 mm

Weight 0.63 kg

Installation DIN-Rail, Wall Mounting

Environmental

Operating Temperature 0 to 60°C (32 to 140°F),
-40 to 75°C (-40 to 167°F) for – T models

Storage Temperature -40 to 85°C (-40 to 185°F)

Ambient Relative Humidity 5 to 90% (non-condensing)

Regulatory Approvals

Safety UL60950, UL 508, CSA C22.2 No. 60950, EN60950

Hazardous Location UL/cUL Class I, Division 2, Groups A, B, C and D
ATEX Class I, Zone 2, EEx nC IIC

EMI FCC Part 15, CISPR (EN55022) class A

EMS EN61000-4-2 (ESD), level 3

	EN61000-4-3 (RS), level 3
	EN61000-4-4 (EFT), level 3
	EN61000-4-5 (Surge), level 2
	EN61000-4-2 (CS), level 3
Shock	IEC 60068-2-27
Free Fall	IEC 60068-2-32
Vibration	IEC 60068-2-6
WARRANTY	5 years

Revision History

Document Edition	Revision Date	Revision Details
2nd	June 15, 2004	<ol style="list-style-type: none"> Updated the edition of this manual on the title page. Changed the Moxa logo on the title page. Added several “Attention” messages Added one product feature: Operating temperature ranges from 0 to 60°C, or extended operating temperature from -40 to 75°C for (-T) models.
3rd	July 1, 2004	<ol style="list-style-type: none"> Revise 100BaseFX for fiber optic port of ST connector.
4th	Nov. 15, 2004	<ol style="list-style-type: none"> Modify Optical Fiber specs. Improve resolution of figures.

Serial Number

The serial number of a product is made up of 12 alphanumeric characters and includes the region in which the product was manufactured, the year and month the product was manufactured, the product category, and the production number.

Position in Serial Number	Meaning	Possible Values	Example(s)
1	Production Region	0 to 9, or D to Z	"T" means Taiwan
2 and 3	Year	Z = 0, A = 1, B = 2, I = 9	ZH = 2008, II = 2009
4	Month	A = JAN, B = FEB, C = MAR, L = DEC	
5	---	0	Reserved for future use
6 and 7	Product Category	B-type: 00, 01, ..., 09 E-type: 10, 11, ..., 99	
8 to 12	Production Number	B-type: 00001 to 65535 E-type: 00001 to 99999	

For example, a product with serial number **TZDL012012456** was manufactured in Taiwan in December of 2004, is an E-type 12 product, and is the 12,456th product of this type that has been manufactured.

Technical Support Contact Information

www.moxa.com/support

Moxa Americas:
Toll-free: 1-888-669-2872
Tel: +1-714-528-6777
Fax: +1-714-528-6778

Moxa China (Shanghai office):
Toll-free: 800-820-5036
Tel: +86-21-5258-9955
Fax: +86-10-6872-3958

Moxa Europe:
Tel: +49-89-3 70 03 99-0
Fax: +49-89-3 70 03 99-99

Moxa Asia-Pacific:
Tel: +886-2-8919-1230
Fax: +886-2-8919-1231